



Sr. No.	Recommendation	Response (Yes/No/NA)	Supporting Materials
169	Allow third parties to easily verify approval certificates in the public domain	Yes	

URL: <https://boiler.gujarat.gov.in/e-services.htm>

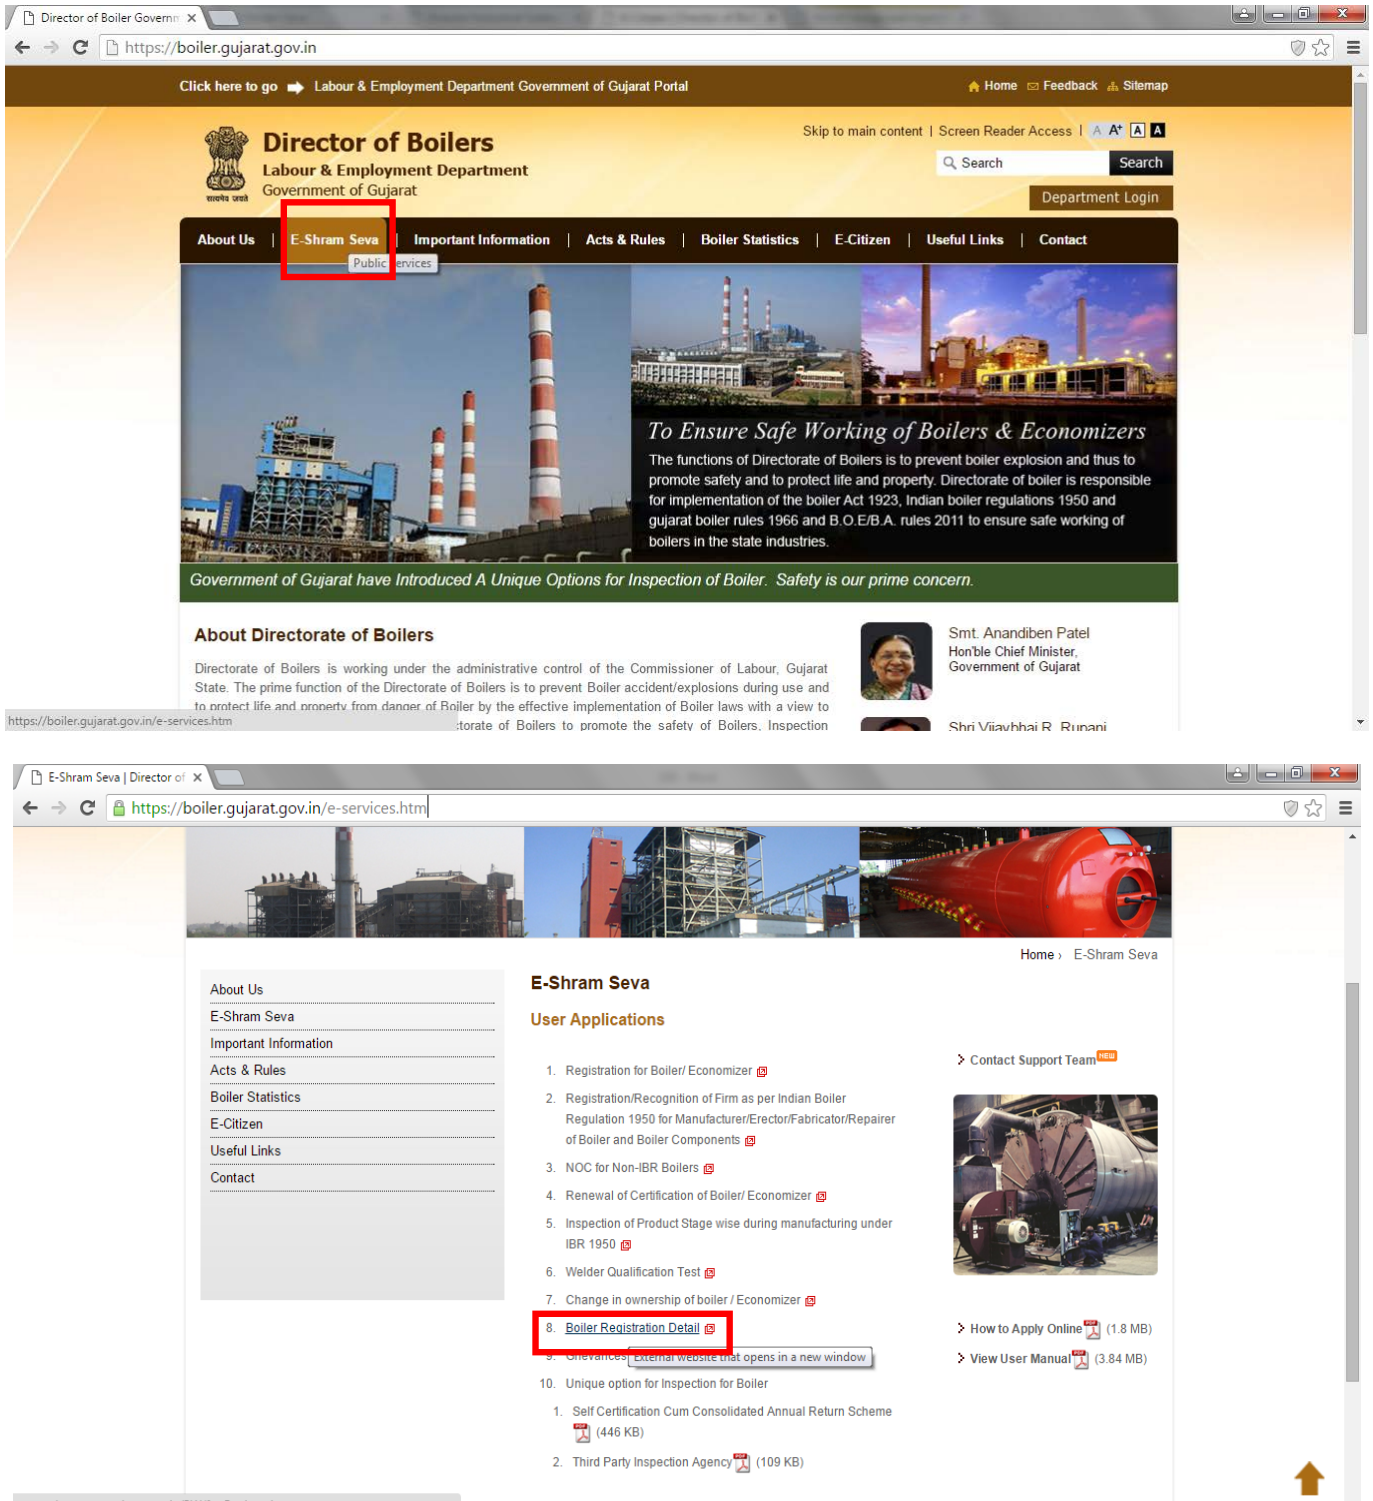

The screenshot shows the website of the Director of Boilers, Government of Gujarat. The top navigation bar includes 'About Us', 'E-Shram Seva', 'Important Information', 'Acts & Rules', 'Boiler Statistics', 'E-Citizen', 'Useful Links', and 'Contact'. The 'E-Shram Seva' menu item is highlighted with a red box. Below the navigation bar, there is a banner with the text 'To Ensure Safe Working of Boilers & Economizers' and a description of the Directorate's functions. A sidebar on the left lists various services, and the main content area displays a list of 'User Applications' under the 'E-Shram Seva' section. The application 'Boiler Registration Detail' is highlighted with a red box. Other applications include registration for boiler/economizer, recognition of firms, NOC for non-IBR boilers, renewal of certification, inspection of product stages, welder qualification tests, and change of ownership. A 'Contact Support Team' button and links to 'How to Apply Online' and 'View User Manual' are also visible.

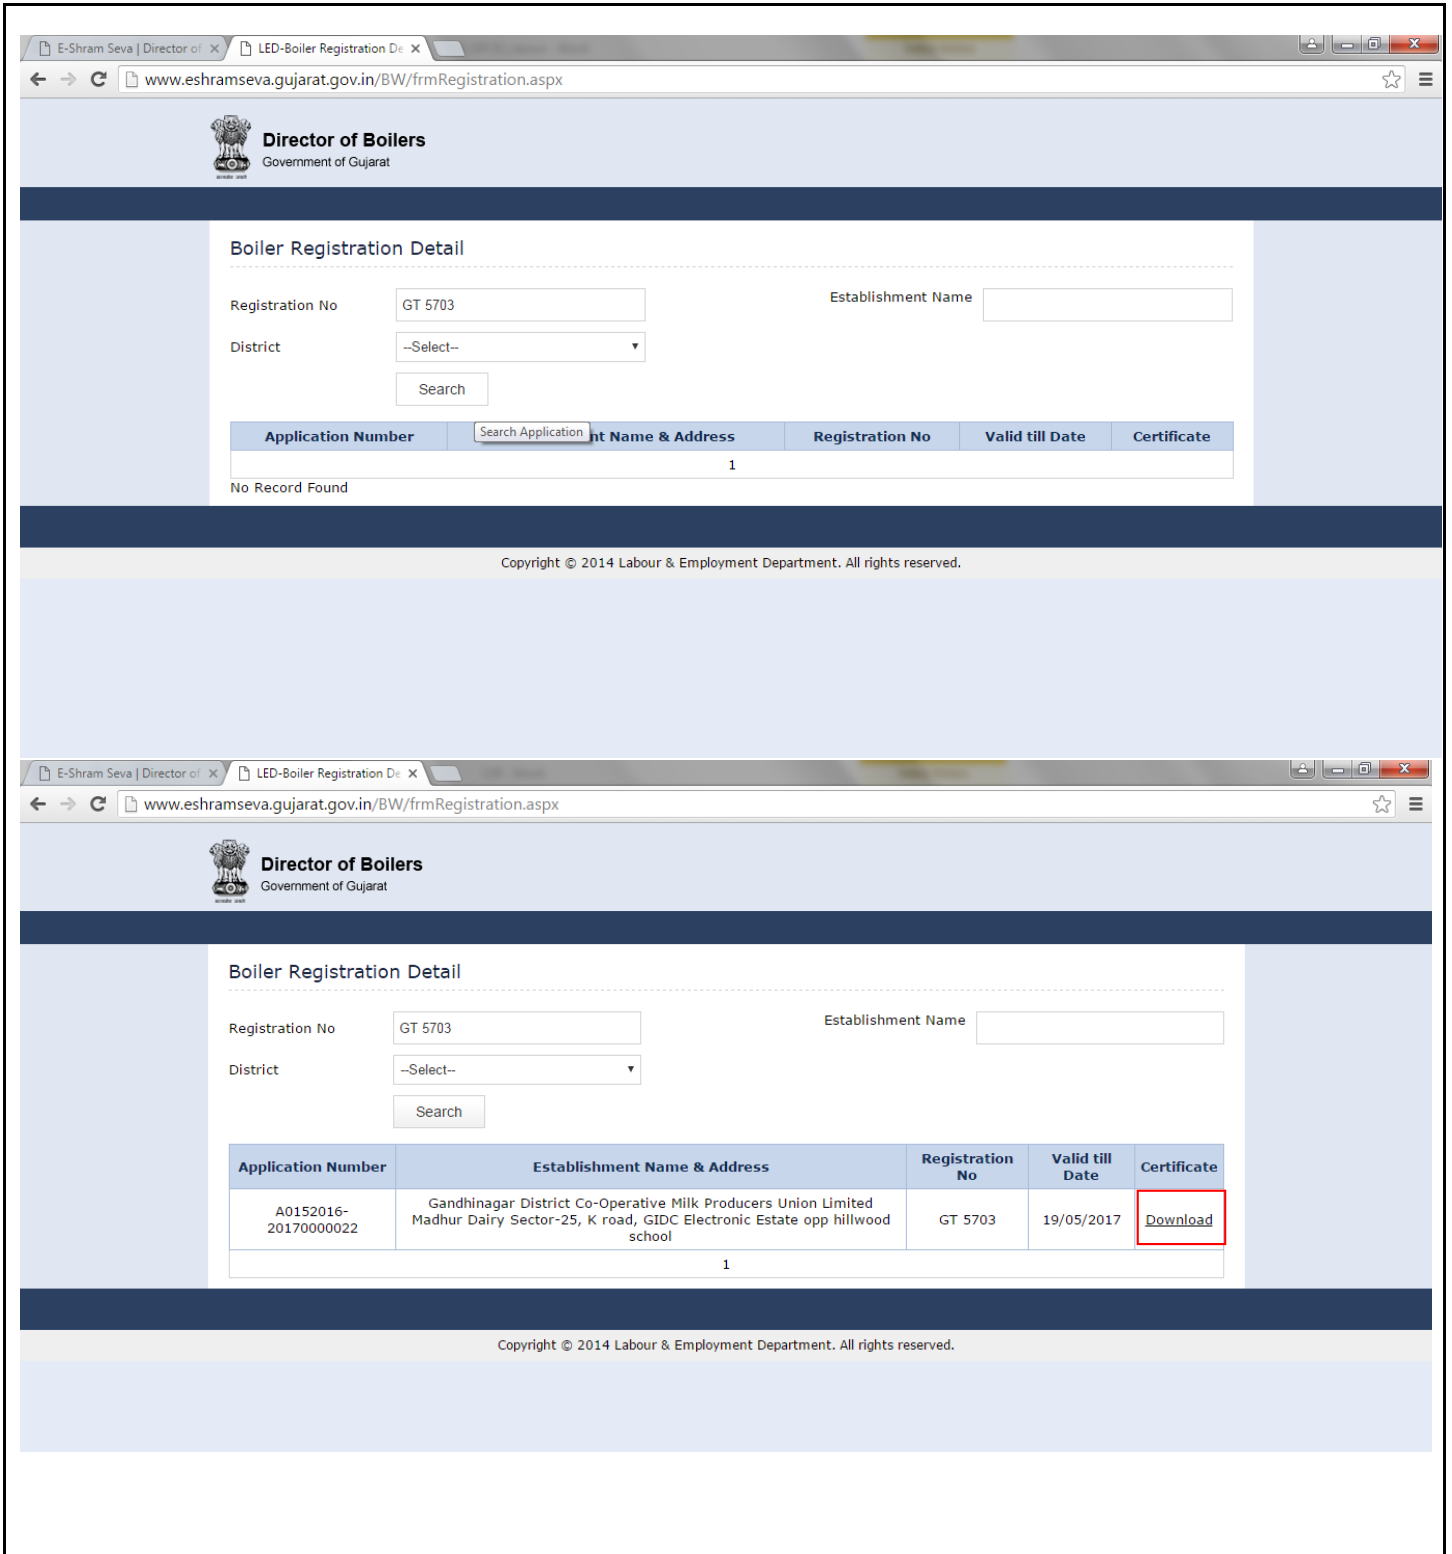

Director of Boilers
Government of Gujarat

Boiler Registration Detail

Registration No: Establishment Name:

District:

Application Number	Establishment Name & Address	Registration No	Valid till Date	Certificate
1				
No Record Found				

Copyright © 2014 Labour & Employment Department. All rights reserved.

Director of Boilers
Government of Gujarat

Boiler Registration Detail

Registration No: Establishment Name:

District:

Application Number	Establishment Name & Address	Registration No	Valid till Date	Certificate
A0152016-2017000022	Gandhinagar District Co-Operative Milk Producers Union Limited Madhur Dairy Sector-25, K road, GIDC Electronic Estate opp hillwood school	GT 5703	19/05/2017	Download
1				

Copyright © 2014 Labour & Employment Department. All rights reserved.

(Spl. S. B. 45-e)

(THIS CERTIFICATE MUST BE HUNG UP IN THE BOILER HOUSE)



No. 008
CA032016-20170000046



10979
125 MAY 2016

FORM VI
(Regulation 389)

GUJARAT BOILER INSPECTION DEPARTMENT
CERTIFICATE FOR THE USE OF A BOILER

Registry No. of Boiler GT -5703	Type of Boiler Package
Boiler Rating 58.0 M ²	Place & year of Manufacture- Pune -2007
Maximum continuous evaporation:	
Name of owner : Gandhinagar Dist.Co.Op.Milk Producer's Union Ltd.	
Situation of Boiler: Madhur Dairy, Sector-25, "K" Road, GIDC Electronics Estate, Gandhinagar	
Repairs :	Nil
Remarks :	Nil
Hydraulically tested on 19/05/2016 to 16.0 Kg/cm ² (g)	

I here by certify that the above described boiler is permitted by Shree R.B.Joshi, The Asst. Director of Boiler under the provisions of Section 7 / 8 of the Boilers Act. No.V (Amended -2007) of 1923 to be worked at a maximum pressure of 10.55 Kg/cm²(g) for the period from 20/05/2016 to 19/05/2017

The loading of the each 24.5mm safety valve is not to exceed 10.55 kg/cm² (g) Cws SPSL not to exceed 10.55 kg/cm² (g) thick F=16.0mm R=16.5mm thick.

I Further certify that the main steam pipe was tested hydraulically to a pressure of - kgms. per sq. cm. last on -.

Fee Rs. 2700/- paid on 29/04/2016. Vr.No.409

Dated at : Ahmedabad

This 19th day of May- 2016

OPEN UP BOILER FOR CLEANING

AFTER EVERY TWENTY FOUR WEEK AND

KEEP RECORD.


(R.B. Joshi)

Assistant Director of Boiler.
Gujarat State, Ahmedabad,

Countersigned

Director of Boilers,
Gujarat State.

(See reverse for "Condition")

Conditions
(Reverse of Form VI)

- 1 No structural alteration addition of renewal shall be made to the boiler otherwise than in accordance with Section 12 of the Act.
- 2 Under the provisions of Section 8 of the Act. this certificate shall cease to be in force-
 - a. On the expiry of the period for which it was granted; or
 - b. When any accident occurs to the boiler; or
 - c. When the boiler is moved, the boiler not being a vertical boiler the heating surface of which is less than 18.58 sq. meters of a portable vehicular boilers; or
 - d. When any structural alteration addition or renewal is made in or to the boiler ; or
 - e. If the Director in any particular case so directs when any structural alteration, addition or renewal is made in or to any steam pipe attached to the boiler; or
 - f. On the communication to the owner of the boiler; of an order of the Director or Assistant Director prohibiting its use on the ground that it or any steam pipe attached there to is in a dangerous condition.

“ Under Section 10 of the Act. when the period of a certificate relation to a boiler has expired , the owner shall, provided that he has applied before the expired of that period for a renewal of the certificate, be entitled to use the boiler at the maximum pressure entered in the former certificate, pending the issue of orders on the application but this shall not be deemed to authorize the use of a boiler in any of the cases referred to in clause (e), (c),(d) and (f) of sub- Section (1) of the section 8 occurring after the expiry of the period of Certificate ”.
- 3 The boiler shall not be used at a pressure greater than the pressure entered in the certificate as the maximum pressure or with the safety valve set to a pressure exceeding such maximum pressure.
- 4 The boiler shall not used otherwise than in a condition which the owner reasonably believes to be compatible with safe working.

NB: - Detail regarding this boiler are recorded in Registration Book No. _____ of which copy may be obtained of payment on application to the Director.