


Sr. No.	Recommendation	Response (Yes/No/NA)	Supporting Materials
189	Allow third parties to easily verify approval certificates in the public domain	Yes	

URL: http://www.gercin.org/uploaded/document/en_1301916429.pdf
<http://www.mgvcl.com/Upload/GERC/09.pdf>
<http://www.dgvcl.com/dgvclweb/viewpdf.php?type=pdf&filename=Supply%20Code%20530%20of%202015.pdf>
<http://www.ugvcl.com/regulation/Supply%20Code%20530%20of%202015.pdf>
<http://www.pgvcl.com/download/REGULATION/Supply%20Code20Nov15.pdf>

Govt. authorized Electrical contractor test report to be submitted with charges.
 Where point 8 SOP of distribution licenses Chapter IV section 4.39 to 4.41
http://www.gercin.org/uploaded/document/en_1301916429.pdf

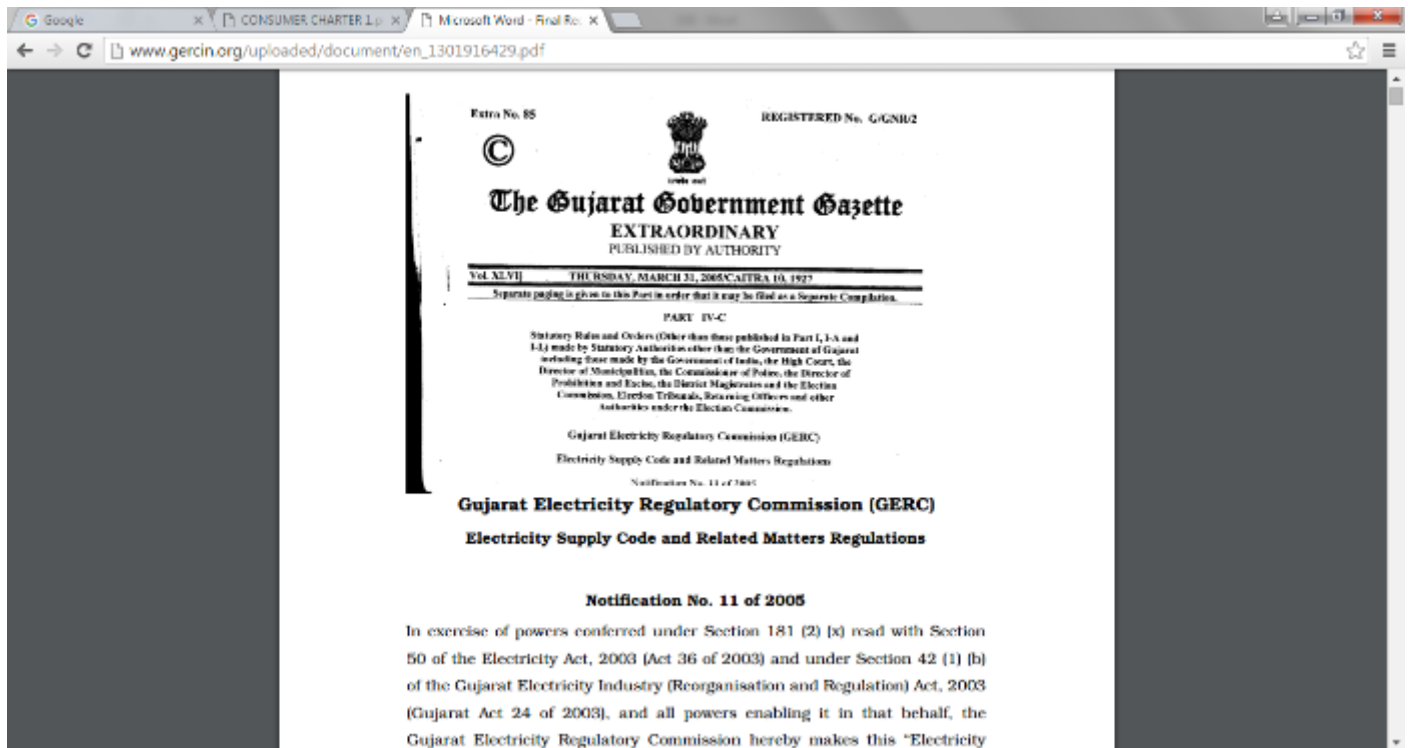

The screenshot displays a web browser window with the following content:

Extra No. 85 REGISTERED No. G/GNU2

The Gujarat Government Gazette
 EXTRAORDINARY
 PUBLISHED BY AUTHORITY

Vol. XLVII THURSDAY, MARCH 31, 2005 (AITRA 10, 1927)

Separate paging is given to this Part in order that it may be filed as a Separate Compilation.

PART IV-C


Statutory Rules and Orders (Other than those published in Part I, I-A and I-L) made by Statutory Authorities other than the Government of Gujarat including those made by the Government of India, the High Court, the Director of Municipalities, the Commissioner of Police, the Director of Prohibition and Excise, the District Magistrates and the Election Commission, Election Tribunals, Returning Officers and other authorities under the Election Commission.

Gujarat Electricity Regulatory Commission (GERC)
 Electricity Supply Code and Related Matters Regulations
 Notification No. 11 of 2005

Gujarat Electricity Regulatory Commission (GERC)
Electricity Supply Code and Related Matters Regulations

Notification No. 11 of 2005

In exercise of powers conferred under Section 181 (2) (x) read with Section 50 of the Electricity Act, 2003 (Act 36 of 2003) and under Section 42 (1) (b) of the Gujarat Electricity Industry (Reorganisation and Regulation) Act, 2003 (Gujarat Act 24 of 2003), and all powers enabling it in that behalf, the Gujarat Electricity Regulatory Commission hereby makes this "Electricity

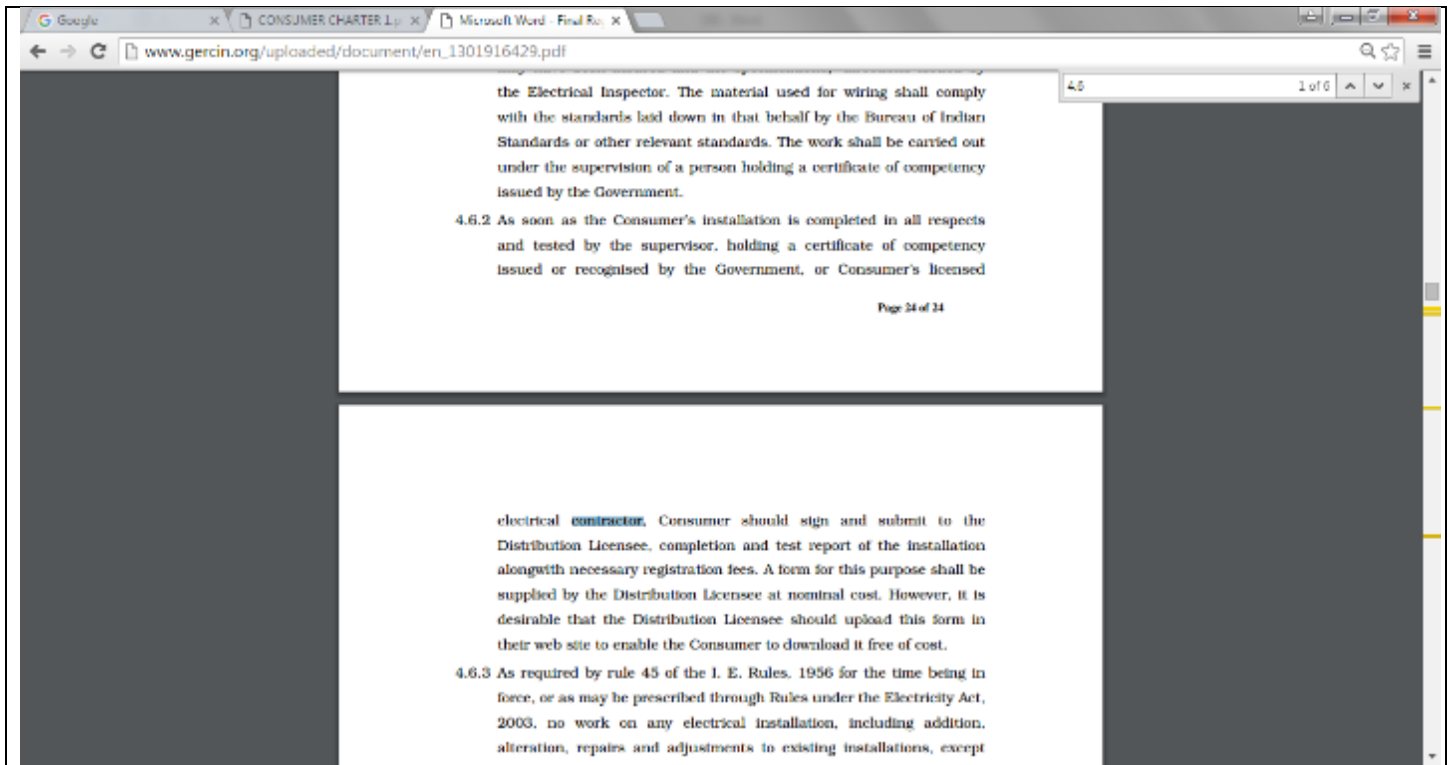

UGVCL: <http://www.ugvcl.com/regulation/Supply%20Code%20530%20of%202015.pdf>



www.ugvcl.com/regulation/regulation.htm



UGVCL
Uttar Gujarat Vij Company Ltd.
 CIN : U40102GJ2003SGC042906 An ISO 9001:2008 Certified Company

Home About Us Legal Suppliers Consumer Careers Download Other Links

Details of GERC Regulations (Updated status as on 26/11/2015)

Sr. No.	Name of Regulation	Notification Number	Date of Notification
01	Grid Code	05 of 2004	25/08/2004
02	Distribution Code	06 of 2004	25/08/2004
02A	Distribution code (First Amendment)	GERC/T-I/2296/2006	26/10/2006
03	Procedure for filing Appeal before the Appellate Authority Regulations	01 of 2005	07/01/2005
04	Fees, fines and Charges Regulations	06 of 2005	30/03/2005
05	Power System Management Standards	07 of 2005	30/03/2005
06	Security Deposit Regulations	08 of 2005	31/03/2005
06A	Security Deposit (Removal of Difficulties order of 2008)	01 of 2008	11/04/2008
06B	Security Deposit Regulations (First Amendment)	5 of 2010	21/08/2010
06C	Security Deposit Regulations (Second Amendment)	3 of 2015	15/07/2015
07	Licensee's Power to recover expenditure incurred in providing supply and Miscellaneous charges	09 of 2005	31/03/2005
08	Standard of Performance of Distribution Licensee	10 of 2005	31/03/2005
09	Electricity Supply code and related matters	530 of 2015	24/09/2015
10	Terms and Conditions of Tariff	12 of 2005	31/03/2005
11	Power Procurement from Co-generation and Renewable Sources by Distribution Licensee	15 of 2005	29/10/2005
12	Multi Year Tariff Regulations 2011	1 of 2011	07/04/2011


www.ugvcl.com/regulation/Supply Code 530 of 2015.pdf

Google x Supply Code 530 of 2015 x Paschim Gujarat Vij Comp x Supply Code 530 of 2015 x

www.ugvcl.com/regulation/Supply%20Code%20530%20of%202015.pdf

Extra No. 530

©



સત્યમેવ જયતે

વાર્ષિક લવાજમનો દર રૂ. ૩૫૦૦/-

The Gujarat Government Gazette

EXTRAORDINARY

PUBLISHED BY AUTHORITY

Vol. LVI | THURSDAY, SEPTEMBER 24, 2015/ASVINA 2, 1937

Separate paging is given to this Part in order that it may be filed as a Separate Compilation.

PART IV-C

Statutory Rules and Orders (Other than those published in Parts I, I-A and I-L) made by Statutory Authorities other than the Government of Gujarat including those made by the Government of India, the High Courts, the Director of Municipalities, the Commissioner of Police, the Director of Prohibition and Excise, the District Magistrates and the Election Commission, Election Tribunals, Returning Officers and other authorities under the Election Commission.

Gujarat Electricity Regulatory Commission (GERC)
Electricity Supply Code and Related Matters Regulations
Notification No. 4 of 2015

www.ugvcl.com/regulation/Supply%20Code%20530%20of%202015.pdf

PART IV C] GUJARAT GOVERNMENT GAZETTE EX., 24-09-2015 530-21

4.39 In case the applicant had opted to get the extension work done himself and/or the applicants installation in the premise where the supply has been demanded is completed in all respect and tested by the supervisor, holding a certificate of competency issued or recognized by the Government, the applicant should sign and submit to the Distribution Licensee, completion and test report of the installation along with necessary test report charges specified in GERC (Licensee's Power to recover Expenditure incurred in providing electricity and other Miscellaneous Charges) Regulations, 2005, as amended from time to time, the licensee shall on receipt of the test report stipulate a date for testing the consumer installation through mutual consultation, under written acknowledgment. The date of testing must be scheduled within 7 working days in Class-I cities and Urban Areas and 10 working days in Rural Areas from the date of receipt of such information:

Provided that if the electric installation exceeds 650 Volts, it will require to be inspected by the Electrical Inspector and written approval thereof be obtained before commencement of supply.

The test report form for this purpose shall be supplied by the Distribution Licensee.

4.40 The applicant or his authorized representative shall be present during testing along with the Licensed Electrical Contractor or his authorized representative who had undertaken the installation. If the consumer installation is found satisfactory the licensee shall arrange to install the meter & accessories and seal the meter, meter box, and accessories in the presence of the consumer and provide electricity supply within 2 working days of the date of testing.


4.41 If the licensee is not satisfied, applicant shall be intimated on the spot in writing, under acknowledgment, of the faults/shortcoming in the consumer installation. The applicant, after rectification of the defects, will intimate the licensee in writing after which the licensee shall again follow the procedure as laid down in clause 4.43 of this Code.

4.42 On completion of the work, Licensee shall inform to the applicant for availing the power supply and if the applicant fails to avail of the power within the period of sixty days from such intimation, he shall be liable to pay the demand charges and minimum monthly charges as applicable. The Distribution Licensee may, in special circumstances, extend the above period of sixty days.

4.43 After re-testing of the consumer installation and payment of prescribed fee (no fee shall be charged by the licensee for the first test but subsequent tests due to faults/shortcomings found in the initial test shall be charged), if the consumer installation is found satisfactory by the licensee, the licensee shall provide electricity supply after fixing the meter & accessories and sealing the same in the presence of the applicant within 2 working days of such re-testing.

4.44 Other conditions for payment of charges shall be as follows:—


MGVCL:

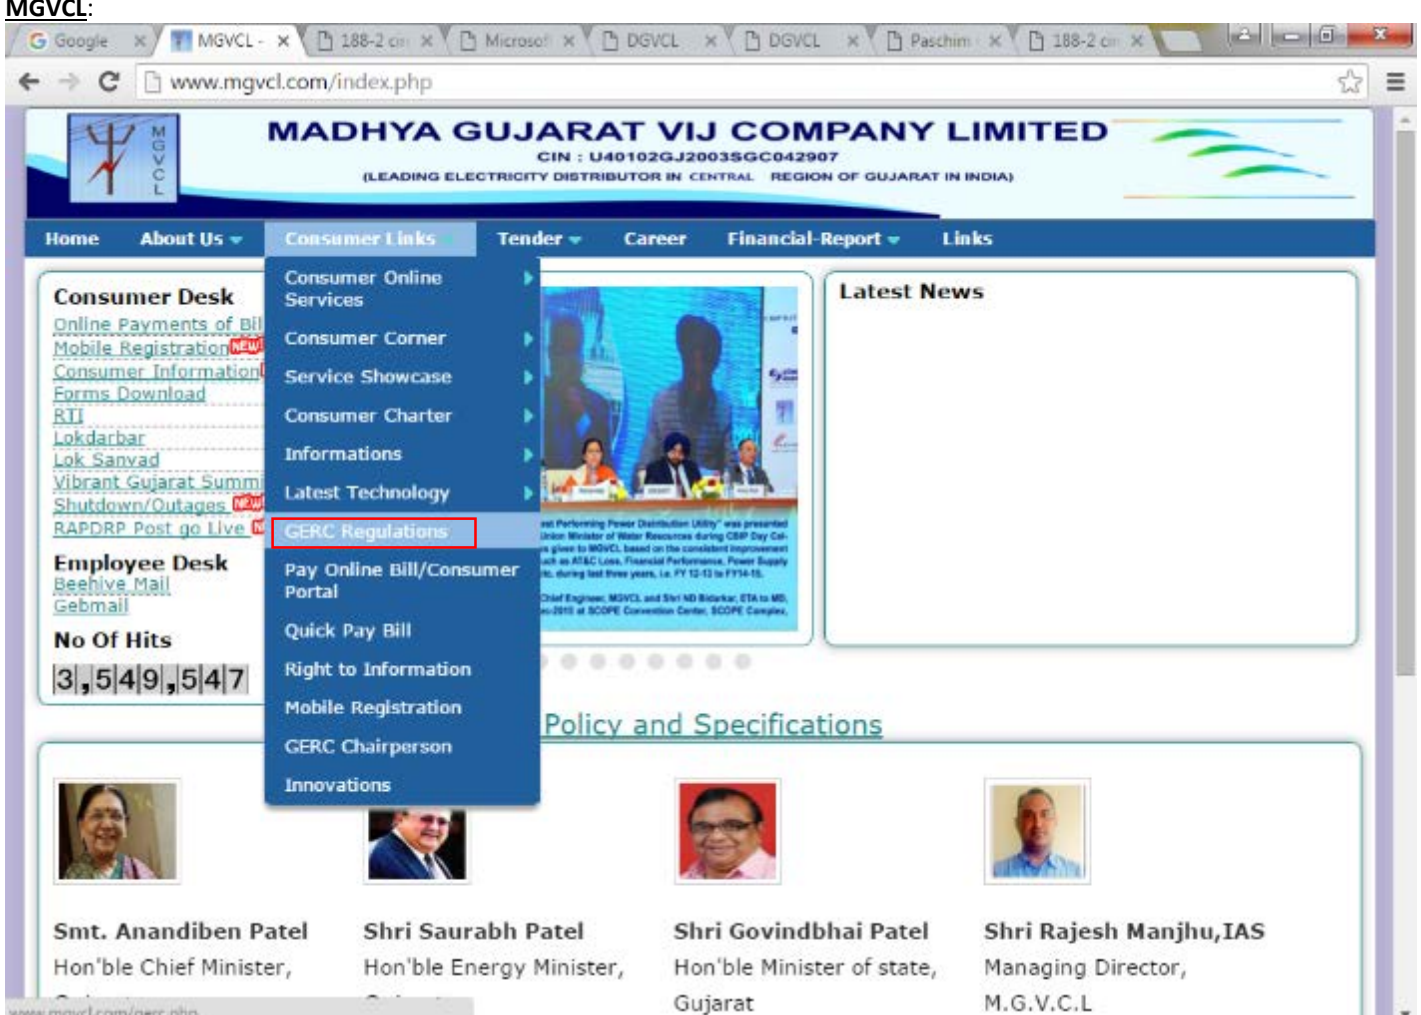

The screenshot shows the MGVC Limited website interface. The browser address bar displays www.mgvcl.com/index.php. The website header includes the MGVC logo and the text "MADHYA GUJARAT VIJ COMPANY LIMITED" with the tagline "LEADING ELECTRICITY DISTRIBUTOR IN CENTRAL REGION OF GUJARAT IN INDIA". The navigation menu includes "Home", "About Us", "Consumer Links", "Tender", "Career", "Financial-Report", and "Links". The "Consumer Links" dropdown menu is open, listing various services such as "Consumer Online Services", "Consumer Corner", "Service Showcase", "Consumer Charter", "Informations", "Latest Technology", "GERC Regulations", "Pay Online Bill/Consumer Portal", "Quick Pay Bill", "Right to Information", "Mobile Registration", "GERC Chairperson", and "Innovations". The "GERC Regulations" option is highlighted with a red box. The main content area features a "Consumer Desk" with links for "Online Payments of Bill", "Mobile Registration", "Consumer Information", "Forms Download", "RTI", "Lokdarbar", "Lok Sanvad", "Vibrant Gujarat Summit", "Shutdown/Outages", and "RAPDRP Post go Live". There is also an "Employee Desk" with "Beehive Mail" and "Gedmail" links, and a "No Of Hits" counter showing "3,549,547". A "Latest News" section is visible on the right. Below the navigation menu, there is a "Policy and Specifications" section with four portraits of key personnel: Smt. Anandiben Patel (Hon'ble Chief Minister), Shri Saurabh Patel (Hon'ble Energy Minister), Shri Govindbhai Patel (Hon'ble Minister of state, Gujarat), and Shri Rajesh Manjhu, IAS (Managing Director, M.G.V.C.L.).

6A	Security Deposit (Removal of Difficulties order of 2008)	01 of 2008	11/04/2008
6B	Security Deposit Regulations (First Amendment)	5 of 2010	21/08/2010
6C	Security Deposit Regulations (Second Amendment)	3 of 2015	15/07/2015
7	Licensee's Power to recover expenditure incurred in providing supply and Miscellaneous charges	09 of 2005	31/03/2005
8	Standard of Performance of Distribution Licensee	10 of 2005	31/03/2005
9	Electricity Supply code and related matters	530 of 2015	24/09/2015
10	Terms and Conditions of Tariff	12 of 2005	31/03/2005
11	Power Procurement from Co-generation and Renewable Sources by Distribution Licensee	15 of 2005	29/10/2005
12	Multi Year Tariff Regulations 2011	1 of 2011	07/04/2011
13	CGRF & Ombudsman Regulations, 2011	2 of 2011	07/04/2011
14	Open Access Regulations	3 of 2011	01/06/2011
15	Demand Side Management Regulations	1 of 2012	08/05/2012
15A	DSM Objectives	-	06/08/2012

www.mgvcl.com/Upload/GERC/09.pdf

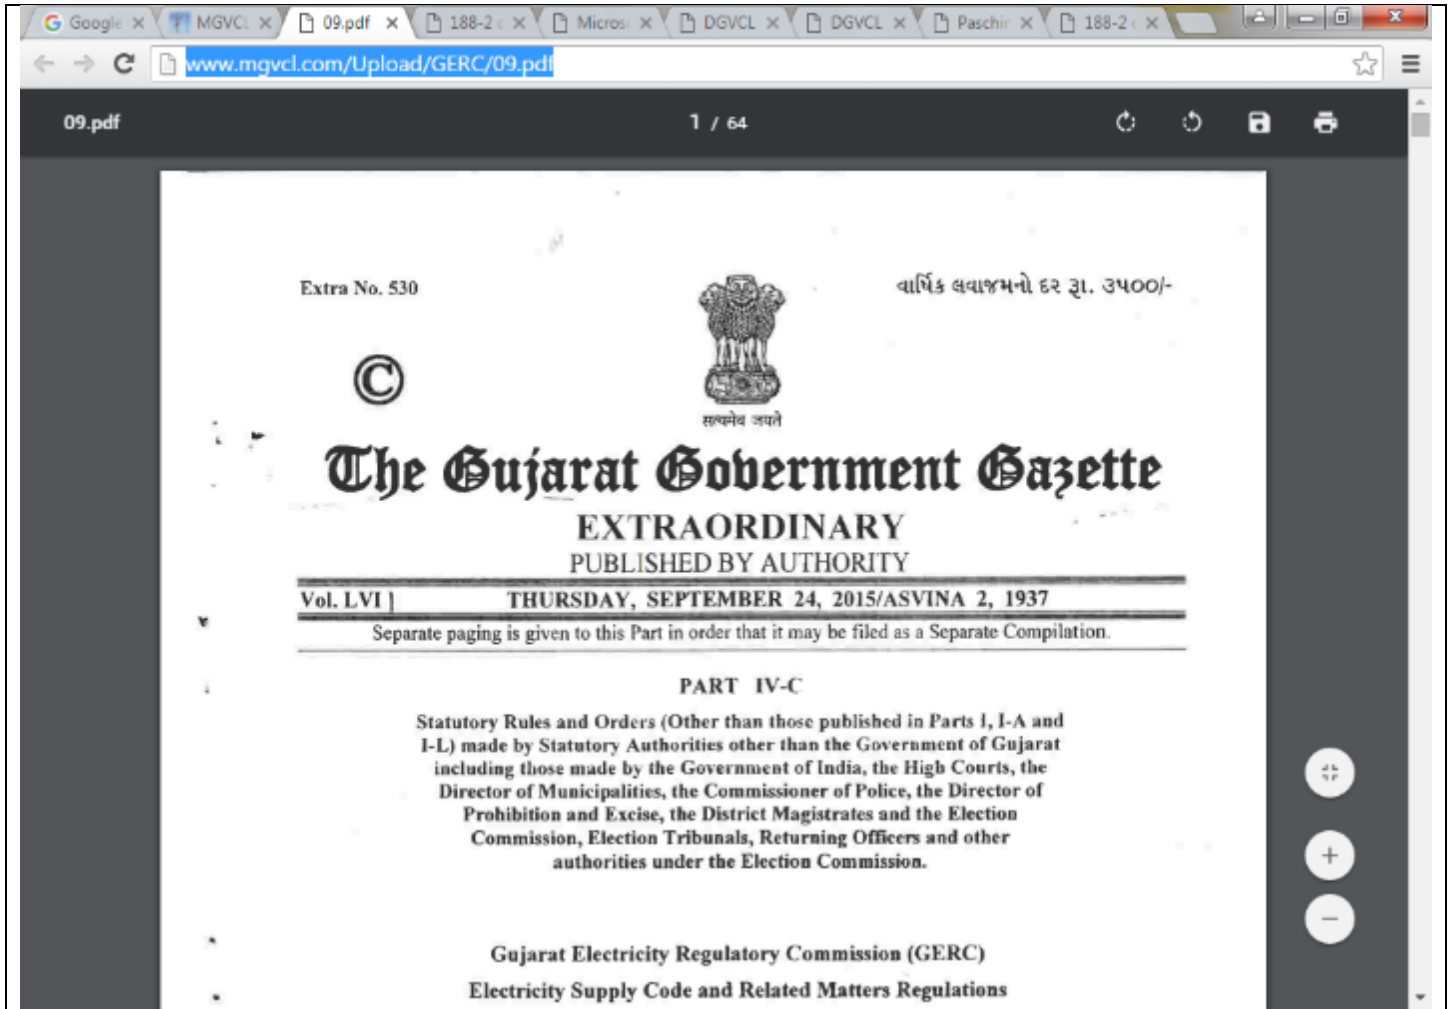

09.pdf 1 / 64

Extra No. 530

©

સત્યમેવ જયતે

વાર્ષિક લઘાજમનો દર રૂ. ૩૫૦૦/-

The Gujarat Government Gazette

EXTRAORDINARY
PUBLISHED BY AUTHORITY

Vol. LVI | THURSDAY, SEPTEMBER 24, 2015/ASVINA 2, 1937

Separate paging is given to this Part in order that it may be filed as a Separate Compilation.

PART IV-C

Statutory Rules and Orders (Other than those published in Parts I, I-A and I-L) made by Statutory Authorities other than the Government of Gujarat including those made by the Government of India, the High Courts, the Director of Municipalities, the Commissioner of Police, the Director of Prohibition and Excise, the District Magistrates and the Election Commission, Election Tribunals, Returning Officers and other authorities under the Election Commission.

Gujarat Electricity Regulatory Commission (GERC)
Electricity Supply Code and Related Matters Regulations

www.mgvcl.com/Upload/GERC/09.pdf

PART IV C] GUJARAT GOVERNMENT GAZETTE EX., 24-09-2015 530-21

4.39 In case the applicant had opted to get the extension work done himself and/or the applicants installation in the premise where the supply has been demanded is completed in all respect and tested by the supervisor, holding a certificate of competency issued or recognized by the Government, the applicant should sign and submit to the Distribution Licensee, completion and test report of the installation along with necessary test report charges specified in GERC (Licensee's Power to recover Expenditure incurred in providing electricity and other Miscellaneous Charges) Regulations, 2005, as amended from time to time, the licensee shall on receipt of the test report stipulate a date for testing the consumer installation through mutual consultation, under written acknowledgment. The date of testing must be scheduled within 7 working days in Class-I cities and Urban Areas and 10 working days in Rural Areas from the date of receipt of such information:

Provided that if the electric installation exceeds 650 Volts, it will require to be inspected by the Electrical Inspector and written approval thereof be obtained before commencement of supply.

The test report form for this purpose shall be supplied by the Distribution Licensee.

4.40 The applicant or his authorized representative shall be present during testing along with the Licensed Electrical Contractor or his authorized representative who had undertaken the installation. If the consumer installation is found satisfactory the licensee shall arrange to install the meter & accessories and seal the meter, meter box, and accessories in the presence of the consumer and provide electricity supply within 2 working days of the date of testing.


4.41 If the licensee is not satisfied, applicant shall be intimated on the spot in writing, under acknowledgment, of the faults/shortcoming in the consumer installation. The applicant, after rectification of the defects, will intimate the licensee in writing after which the licensee shall again follow the procedure as laid down in clause 4.43 of this Code.

4.42 On completion of the work, Licensee shall inform to the applicant for availing the power supply and if the applicant fails to avail of the power within the period of sixty days from such intimation, he shall be liable to pay the demand charges and minimum monthly charges as applicable. The Distribution Licensee may, in special circumstances, extend the above period of sixty days.

4.43 After re-testing of the consumer installation and payment of prescribed fee (no fee shall be charged by the licensee for the first test but subsequent tests due to faults/shortcomings found in the initial test shall be charged), if the consumer installation is found satisfactory by the licensee, the licensee shall provide electricity supply after fixing the meter & accessories and sealing the same in the presence of the applicant within 2 working days of such re-testing.

4.44 Other conditions for the contract of supply shall be as specified in the order of the date

DGVCL:



The screenshot shows the DGVCL website interface with the following sections:

- Media Corner:** Candidates who applied for the post of VS-JE(Elect) held at 04.09.2015 kindly visit advertisement section. DGVCL is ranked number one DISCOM in the country bagging A+ Rating for its consistent financial and operational efficiency. DGVCL received highest rating in the Third Annual Integrated Ratings among a total 40 stated owned distribution utilities rated by ICRA Ltd. & Credit Analysis and Research Ltd. as per the framework approved by Ministry of Power.
- What is New?:** RAPDRP Post Go Live Reports, Lok Darbar, Lok Samvad, Advertisement, Solar Pump Set Scheme 2014-15, Photo Gallery, Urja Jyoti (Magazine), Circulars, GERC Supply Code.
- Consumer Corner:** Planned Shutdown/Outages, Report Energy Misuse, Urja Suraksha Setu, AG pending application, Do's & Don'ts, CGRF, Register Your Complaint Through SMS, Consumer Address Detail.
- Way Forward:** DSM Programme, SCADA implementation in Surat, DGVCL's customer care center, Project cell vision - 2016, ABC/LPE Conductor proposed on JGY Feeders & Urban slum areas.
- May I Help You?:** Regulations notified by GERC, Right to Information, Electricity Act, Public Information Officer, Quality Policy & Objective, Bill Collection Centers, ATP centers, SOP & RIMs, FAQs.

Additional elements include a 24x7 Customer Care Center contact number (1800-223-3032), a navigation menu with 'Gujarat', 'Minister, Gujarat', and 'Petroleum Minister, Gujarat', and a footer with copyright information (2012 DGVCL), legal disclaimers, and visitor statistics (May 31 2016 17:04:36 | Visitor No. - 68784).

www.dgvcl.com/dgvclweb/gerc.php


DGMCL DAKSHIN GUJARATI VJ COMPANY LTD.
ISO 9001 : 2008 Certified
CIN U40102GJ2003SGC042909

About us Online Payment Save Energy Consumer Service Procurement Doing Business
Contact Us

Details of GERC Regulations

Sr No	Name of Regulation	Notification Number	Date of application	
01	Grid Code	05 of 2004	25/08/2004	View/Download
02	Distribution Code	06 of 2004	25/08/2004	View/Download
02A	Distribution code (First Amendment)	GERC/T-1/2296/2006	26/10/2006	View/Download
03	Procedure for filing Appeal before the Appellate Authority Regulations	01 of 2005	07/01/2005	View/Download
04	Fees, fines and Charges Regulations	06 of 2005	30/03/2005	View/Download
05	Power System Management Standards	07 of 2005	30/03/2005	View/Download
06	Security Deposit Regulations	08 of 2005	31/03/2005	View/Download
06A	Security Deposit (Removal of Difficulties order of 2008)	01 of 2008	11/04/2008	View/Download
06B	Security Deposit Regulations (First Amendment)	5 of 2010	21/08/2010	View/Download
06C	Security Deposit Regulations (Second Amendment)	3 of 2015	15/07/2015	View/Download
07	Licenses Power to recover expenditure incurred in providing supply and Miscellaneous charges	09 of 2005	31/03/2005	View/Download
08	Standard of Performance of Distribution Licensee	10 of 2005	31/03/2005	View/Download
09	Electricity Supply code and related matters	530 of 2015	24/09/2015	View/Download
10	Terms and Conditions of Tariff	12 of 2005	31/03/2005	View/Download
11	Power Procurement from Co-generation and Renewable Sources by Distribution Licensee	15 of 2005	29/10/2005	View/Download
12	Mult Year Tariff Regulations 2011	1 of 2011	07/04/2011	View/Download
13	CGRF & Ombudsman Regulations, 2011	2 of 2011	07/04/2011	View/Download
14	Open Access Regulations	3 of 2011	01/06/2011	View/Download
15	Demand Side Management Regulations	1 of 2012	08/05/2012	View/Download
15A	DSM Objectives	-	06/08/2012	View/Download

www.dgvcl.com/dgvclweb/viewpdf.php?type=pdf&filename=Supply Code 530 of 2015.pdf

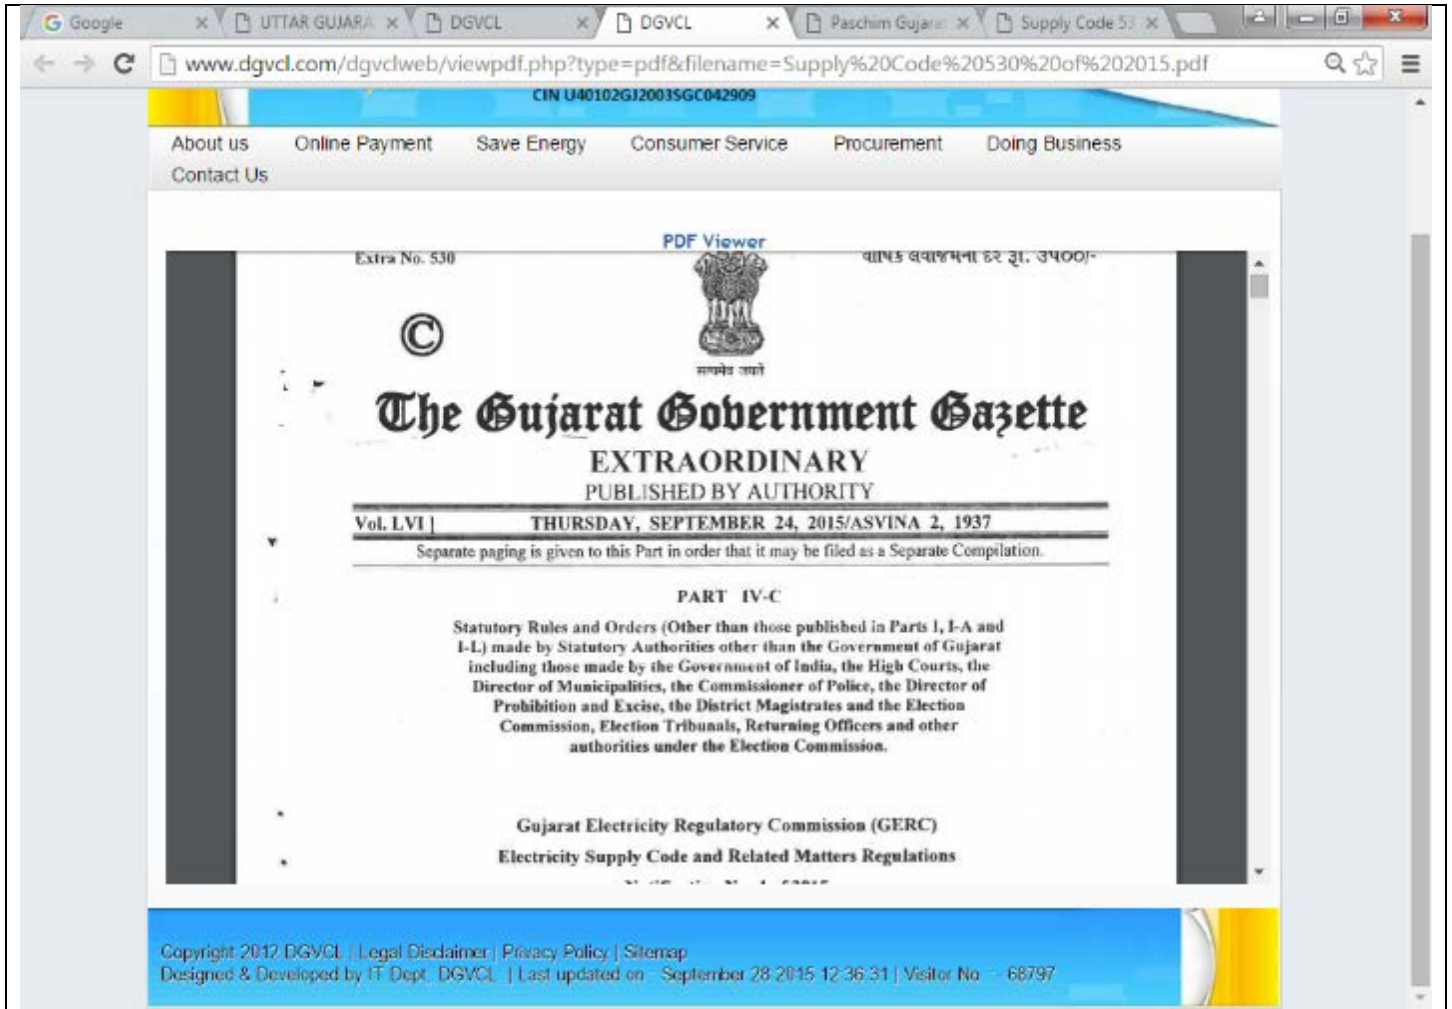

The screenshot shows a web browser window with the address bar displaying www.dgvcl.com/dgvclweb/viewpdf.php?type=pdf&filename=Supply%20Code%20530%20of%202015.pdf. The browser tabs include "UTTAR GUJARAT", "DGVCL", "DGVCL", "Paschim Gujarat", and "Supply Code 53". The page content is a PDF viewer showing the title page of "The Gujarat Government Gazette EXTRAORDINARY". The page includes the Gujarat Government logo, the text "Extra No. 530", and the date "THURSDAY, SEPTEMBER 24, 2015/ASVINA 2, 1937". The main heading is "The Gujarat Government Gazette EXTRAORDINARY PUBLISHED BY AUTHORITY". Below this, it states "PART IV-C Statutory Rules and Orders (Other than those published in Parts I, I-A and I-L) made by Statutory Authorities other than the Government of Gujarat including those made by the Government of India, the High Courts, the Director of Municipalities, the Commissioner of Police, the Director of Prohibition and Excise, the District Magistrates and the Election Commission, Election Tribunals, Returning Officers and other authorities under the Election Commission." At the bottom, it mentions "Gujarat Electricity Regulatory Commission (GERC) Electricity Supply Code and Related Matters Regulations". The footer of the page contains copyright information: "Copyright 2012 DGVCL | Legal Disclaimer | Privacy Policy | Sitemap" and "Designed & Developed by IT Dept. DGVCL | Last updated on - September 28 2015 12:36:31 | Visitor No - 68797".

Google x UTTAR GUJARAT x DGVCL x DGVCL x Paschim Gujarat x Supply Code 53 x

www.dgvcl.com/dgvclweb/viewpdf.php?type=pdf&filename=Supply%20Code%20530%20of%202015.pdf

CIN U40102GJ2003SGC042909

About us Online Payment Save Energy Consumer Service Procurement Doing Business
Contact Us

PDF Viewer

PART IV C] GUJARAT GOVERNMENT GAZETTE EX., 24-09-2015 530-21

4.39 In case the applicant had opted to get the extension work done himself and/or the applicants installation in the premise where the supply has been demanded is completed in all respect and tested by the supervisor, holding a certificate of competency issued or recognized by the Government, the applicant should sign and submit to the Distribution Licensee, completion and test report of the installation along with necessary test report charges specified in GERC (Licensee's Power to recover Expenditure incurred in providing electricity and other Miscellaneous Charges) Regulations, 2005, as amended from time to time, the licensee shall on receipt of the test report stipulate a date for testing the consumer installation through mutual consultation, under written acknowledgment. The date of testing must be scheduled within 7 working days in Class-I cities and Urban Areas and 10 working days in Rural Areas from the date of receipt of such information:
Provided that if the electric installation exceeds 650 Volts, it will require to be inspected by the Electrical Inspector and written approval thereof be obtained before commencement of supply.
The test report form for this purpose shall be supplied by the Distribution Licensee.

4.40 The applicant or his authorized representative shall be present during testing along with the Licensed Electrical Contractor or his authorized representative who had undertaken the installation. If the consumer installation is found satisfactory the licensee shall arrange to install the meter & accessories and seal the meter, meter box, and accessories in the presence of the consumer and provide electricity supply within 2 working days of the date of testing.

4.41 If the licensee is not satisfied, applicant shall be intimated on the spot in writing, under acknowledgment, of the faults/shortcoming in the consumer installation. The applicant, after rectification of the defects, will intimate the licensee in writing after which the licensee shall again follow the procedure as laid down in clause 4.43 of this Code.

4.42 On completion of the work, Licensee shall inform to the applicant for availing the power supply and

Copyright 2012 DGVCL | Legal Disclaimer | Privacy Policy | Sitemap
Designed & Developed by IT Dept. DGVCL | Last updated on - September 28 2015 12:36:31 | Visitor No - 68797

PGVCL:

Google | Paschim Gujarat Vij Comp. | www.pgvcld.com/index.php

PASCHIM GUJARAT VIJ COMPANY LIMITED

CIN : U40102GJ2003SGC042908
(LEADING ELECTRICITY DISTRIBUTOR IN WESTERN REGION OF GUJARAT IN INDIA)



AN ISO 9001:2008 Certified Company

[Right To Information](#) | [Feedback](#) | [Power Complaint](#) | [Employee Corner](#) | [Contact Us](#)

Home | About Us | Consumer Links | Suppliers | Recruitment | Downloads | Useful Links

- Important Circulars
- Electricity Related Acts
- REGULATIONS**
- SOP
- RIMS

Send SMS to book your p...
with 11 digit consume...
comp 12345678901 2...
8469155333. To know...
[Click Here](#)



Latest News

www.pgvcld.com/download/regulation.php



www.pgvcl.com/download/regulation.php

Security Deposit Amendment 2	View / Download
SLDC Charges	View / Download
Standard of Performance	View / Download
Supply Code	View / Download
MYT Regulations 2011	View / Download
Trading Licence	View / Download
Transmission Licence	View / Download
Procurement of Energy from Renewable Sources	View / Download
Guidelines for procurement of Power	View / Download
Appointment of Consultant	View / Download
Meter Regulations	View / Download
Meter Regulations Amendment 1	View / Download
Meter Regulations Amendment 2	View / Download
DSM Regulations	View / Download
Regulations on Safety requirements of Electric Plants and Electric Lines	View / Download

www.pgvcl.com/download/REGULATION/Supply_Code20Nov15.pdf

Google x Paschim Gujarat Vij Comp x Supply Code20Nov15.pdf x
www.pgvd.com/download/REGULATION/Supply%20Code20Nov15.pdf

PART IV C] GUJARAT GOVERNMENT GAZETTE EX., 24-09-2015 530-21

4.39 In case the applicant had opted to get the extension work done himself and/or the applicants installation in the premise where the supply has been demanded is completed in all respect and tested by the supervisor, holding a certificate of competency issued or recognized by the Government, the applicant should sign and submit to the Distribution Licensee, completion and test report of the installation along with necessary test report charges specified in GERC (Licensee's Power to recover Expenditure incurred in providing electricity and other Miscellaneous Charges) Regulations, 2005, as amended from time to time, the licensee shall on receipt of the test report stipulate a date for testing the consumer installation through mutual consultation, under written acknowledgment. The date of testing must be scheduled within 7 working days in Class-I cities and Urban Areas and 10 working days in Rural Areas from the date of receipt of such information:

Provided that if the electric installation exceeds 650 Volts, it will require to be inspected by the Electrical Inspector and written approval thereof be obtained before commencement of supply.

The test report form for this purpose shall be supplied by the Distribution Licensee.

4.40 The applicant or his authorized representative shall be present during testing along with the Licensed Electrical Contractor or his authorized representative who had undertaken the installation. If the consumer installation is found satisfactory the licensee shall arrange to install the meter & accessories and seal the meter, meter box, and accessories in the presence of the consumer and provide electricity supply within 2 working days of the date of testing.

4.41 If the licensee is not satisfied, applicant shall be intimated on the spot in writing, under acknowledgment, of the faults/shortcoming in the consumer installation. The applicant, after rectification of the defects, will intimate the licensee in writing after which the licensee shall again follow the procedure as laid down in clause 4.43 of this Code.

4.42 On completion of the work, Licensee shall inform to the applicant for availing the power supply and if the applicant fails to avail of the power within the period of sixty days from such intimation, he shall be liable to pay the demand charges and minimum monthly charges as applicable. The Distribution Licensee may, in special circumstances, extend the above period of sixty days.

4.43 After re-testing of the consumer installation and payment of prescribed fee (no fee shall be charged by the licensee for the first test but subsequent tests due to faults/shortcomings found in the initial test shall be charged), if the consumer installation is found satisfactory by the licensee, the licensee shall provide electricity supply after fixing the meter & accessories and sealing the same in the presence of the applicant within 2 working days of such re-testing.

4.44 Other conditions being equal, Service Lines shall, as far as possible, be laid in the order of the dates of receipt of the deposit money.